


SECOND FLOOR

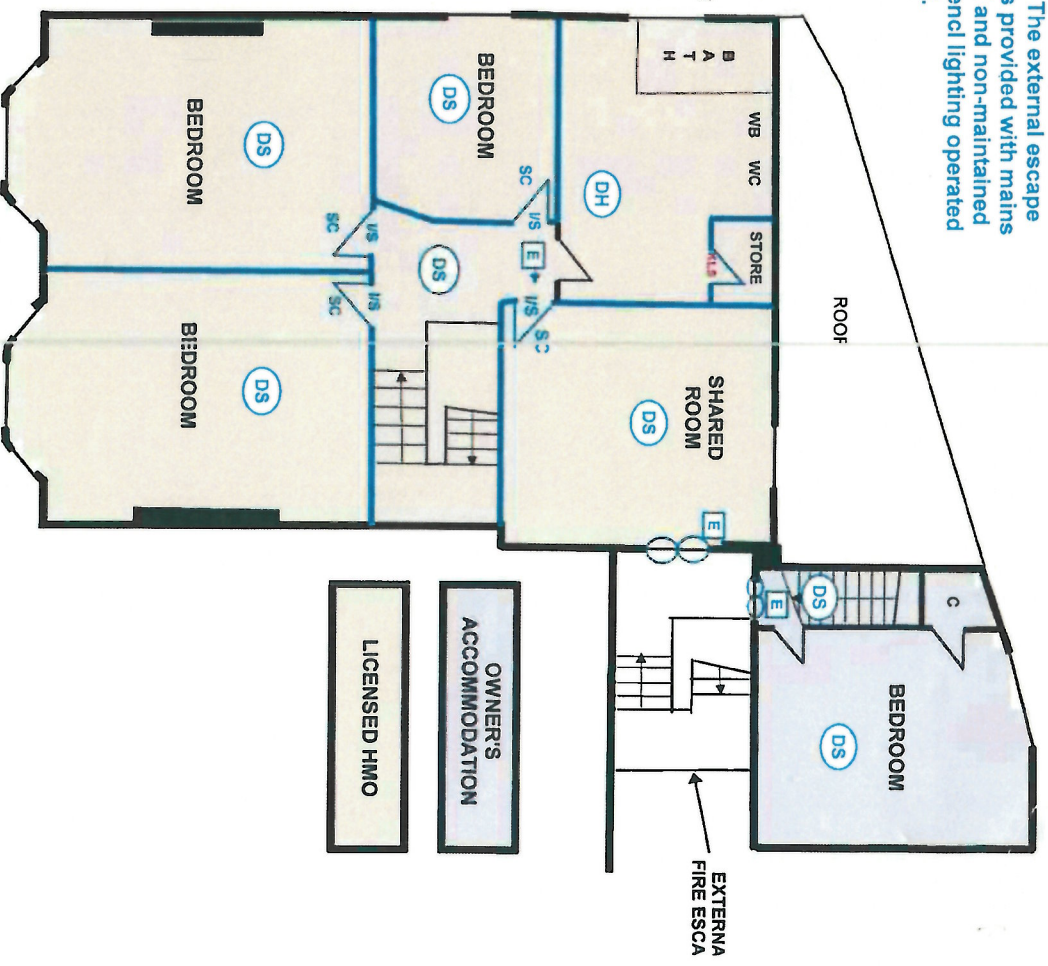

THIRD FLOOR


NOTE: The external escape route is provided with mains normal and non-maintained emergency lighting operated via PIR.

NOTE: The building is provided with a Grade A automatic fire detection and alarm system installed in accordance with the recommendations of BS 5839 Part 6 comprising control panel & heat and smoke detectors located in the areas indicated by the blue symbols on the plans. The commonway escape route is also provided with a non-maintained emergency lighting system installed in accordance with the recommendations of BS 5266 Part 1.

OWNERS ACCOMMODATION
LICENSED HMO

NOT TO SCALE
MOE DRAWN BY: AJG
MOE CHECKED BY:
DATE: 22 February 2018

COLOUR PLAN. DO NOT TAKE BLACK AND WHITE COPIES
THIS PLAN IS COPYRIGHT. DO NOT TAKE COPIES WITHOUT AUTHORITY FROM BRIGHTON & HOVE CITY COUNCIL
HOUSING ACT 2004 - HMO LICENSING

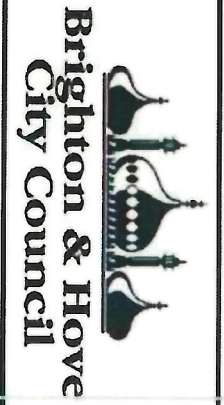

ESFRS